


**SERIES 5800
 MICRO LOGIC TIMER (MLT)**

**INSTALLATION GUIDE
 FOR 58AX / 58BX / 58CX / 581X / 582X / 584X / 585X / 589X**

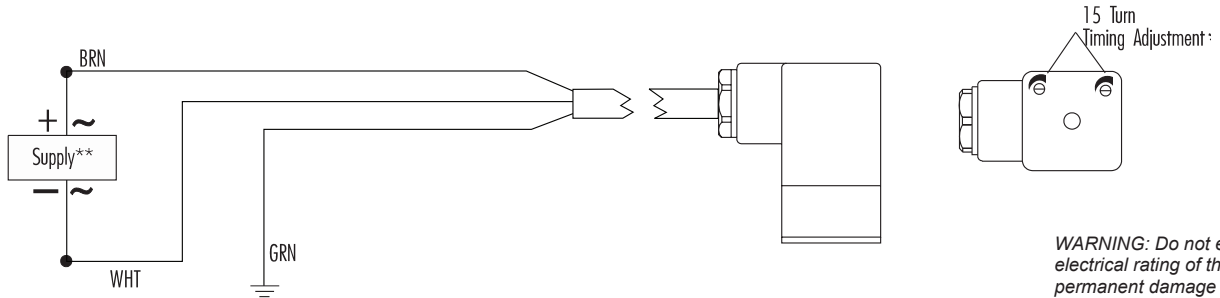

WARNING: Do not exceed the electrical rating of this device or permanent damage can result.


Timing Adjustment:

This timer allows 15 turns of adjustment over the timing range. Divide the selected range by 15. This results in a seconds per turn ratio to aid in your adjustment. The adjustment knob should be turned about 15-20 turns counter-clockwise to insure you are starting at minimum. Add the number of turns clockwise to reach the approximate desired timing. Some additional adjustments may be necessary depending on the desired accuracy.

*Two adjustments for cycling timers only.
 **Polarity must be observed for DC but not for AC operation.


Timing Diagrams

Interval Delay / (One Shot) - Timer Type 1

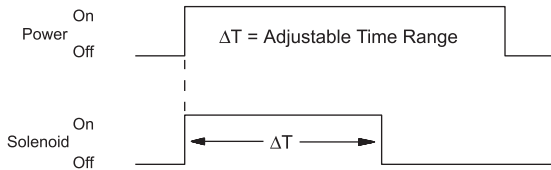


Solenoid is energized for ΔT upon application of power. Reset occurs when power is removed.

Cycle Timer - Timer Type 4 / Type A

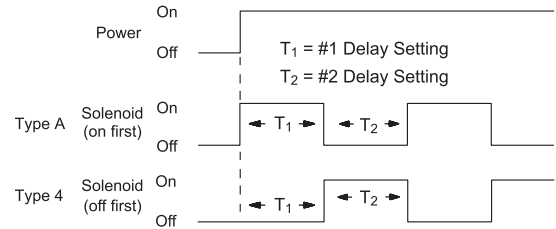


Solenoid cycles ΔT_1 OFF and ΔT_2 ON when power is applied. Reset occurs when power is removed. Timer is available in normally on (Type A) or normally off (Type 4) versions.

On Delay / (Delay On Make) - Timer Type 2

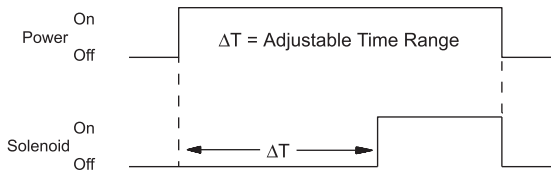


Solenoid remains OFF for ΔT upon application of power. Reset occurs when power is removed.

Square Wave Cycle Timer - Timer Type 5 / Type 9

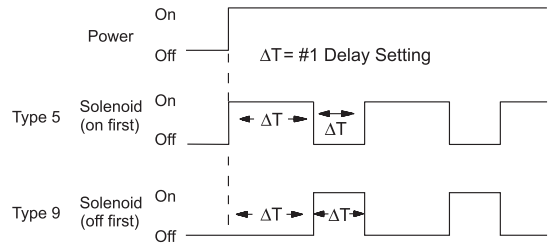

Solenoid cycles with equal ON and OFF times when power is applied. Reset occurs when power is removed. Timer is available in normally on (Type 5) or normally off (Type 9) versions.

Single Cycle Timer - Timer Type B / C

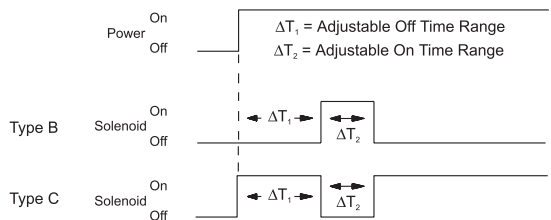

Solenoid cycles ΔT_1 OFF and ΔT_2 ON when power is applied. Reset occurs when power is removed. Timer is available in normally off (Type B) or normally on (Type C) versions.